



NON-INSULATED FIRE RATED ACCESS DOOR Model KRP-250FR For Walls Only



SPECIFICATIONS

GENERAL SCOPE:

The KRP-250 is non-insulated and rated by Underwriters Laboratories for 1.5 hour "B" label in wall, and may be used in 2 hour fire rated wall assembly.

CONSTRUCTION

1. Frame shall be 4 piece welded 16 gage steel.
2. Door shall be 16 gage steel.
3. Hinge shall be exposed, continuous piano hinge.
4. Door shall have automatic closure, be self-latching and contain interior latch release.
5. Latches shall be spring loaded sliding bolt type, keyed paddle latch, all keyed alike. Door can be prepared for a rim cylinder lock.
6. Finish shall be prime coat of rust inhibitive electrostatic powder, baked white enamel. Stainless steel doors shall have #4 satin finish.

FIRE-RATED ACCESS DOOR INSTALL IN SHEET ROCK, MASENRY, TILE OR PLASTER.

STANDARD SIZES

| DOOR SIZE H X W (IN.) | WALL OPENING (IN.) | NUMBER OF LATCHES | SHIP WT. (LBS.) |
|--------------------------|-----------------------|----------------------|--------------------|
| 8 x 8 | 8 3/8 x 8 3/8 | 1 | 5.1 |
| 12 x 12 | 12 3/8 x 12 3/8 | 1 | 8.5 |
| 14 x 14 | 14 3/8 x 14 3/8 | 1 | 9.8 |
| 16 x 16 | 16 3/8 x 16 3/8 | 1 | 11.7 |
| 18 x 18 | 18 3/8 x 18 3/8 | 1 | 13.8 |
| 24 x 24 | 24 3/8 x 24 3/8 | 1 | 20.5 |
| 30 x 22 | 30 3/8 x 22 3/8 | 1 | 22.6 |
| 30 x 30 | 30 3/8 x 30 3/8 | 1 | 28.2 |
| 36 x 24 | 36 3/8 x 24 3/8 | 2 | 28.5 |
| 36 x 36 | 36 3/8 x 36 3/8 | 2 | 39.6 |

DATE

PROJECT DATA

Project Name:

Architect:

Contractor:



Agent/Customer Name:

Tagging Instructions:

Special Instructions:

PROJECT SCHEDULE

| Qty. | H | W | No. of Latches | Finish | Remarks |
|------|---|---|-------------------|--------|---------|
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| | | | | | |

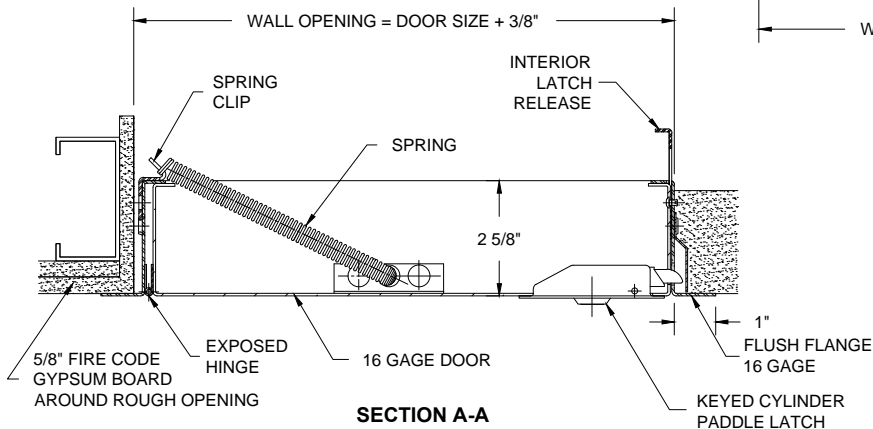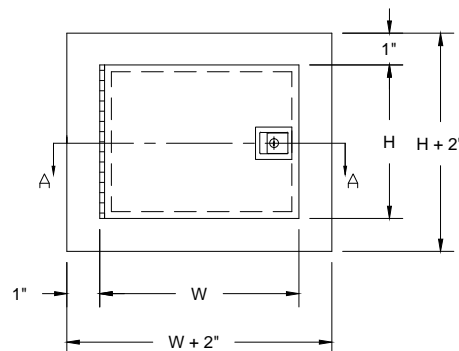

Made with Union Labor



FOR MORE INFORMATION CALL 1-888-926-1365
 Superior Specialty Supply • 9 Council Drive • PO Box 417 • Woodsboro, MD 21798 • www.sssupply.com